


CAMPsites – FIRE SAFETY



FIRE PRECAUTIONS IN CAMP SITES *SPACING*



6 metres between
motorhomes



FIRE PRECAUTIONS IN CAMP SITES TENTS



3 metres
between Tents



FIRE PRECAUTIONS IN CAMP SITES CARRAGEWAYS



- Pitches should be no closer than 3m (10 feet) to a carriageway and no further away than 45m.




FIRE PRECAUTIONS IN CAMP SITES CARRAGEWAYS



FIRE PRECAUTIONS IN CAMP SITES OVERALL SITE



- The maximum gross density is 50 tents to every hectare (2.5 acres).

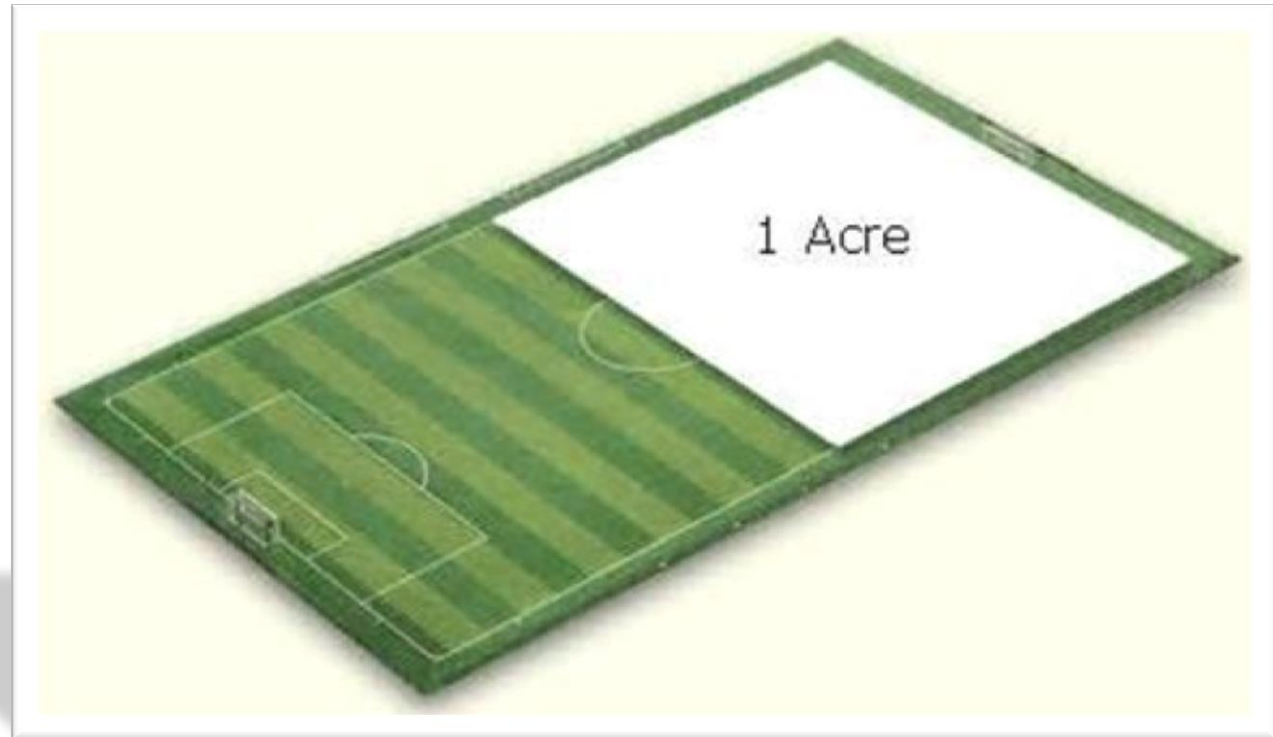

FIRE PRECAUTIONS IN CAMP SITES FIRE POINTS



- Where standpipes are not provided or water pressure is insufficient, a fire point should be provided with either:
 - water extinguishers (2 x 9 litre) or
 - AFFF Foam extinguishers (2 x 6 litre)
- The maximum distance between a fire point and a tent should be no more than 30m
- They should also be marked '**FIRE POINT**'.



FIRE PRECAUTIONS IN CAMP SITES FIRE POINT



FIRE PRECAUTIONS IN CAMP SITES STANDPIPES



- If standpipes are to be provided, they should be sited at each fire point together with a small diameter reel not less than 30m long, having a suitable connection, preferably screw thread to fit the standpipe and have a small hand controlled nozzle.
- There should be sufficient pressure and flow on the main to give a 5m jet at the nozzle.



FIRE PRECAUTIONS IN CAMP SITES RAISING THE ALARM



FIRE NOTICES



Fire notices

A clear conspicuous notice should be provided and maintained at each fire point to indicate the action to be taken and the location of the nearest telephone. The notice should include:

On discovering a fire,

- (1) Ensure the tent or site building involved is evacuated.
- (2) Raise the alarm.
- (3) Call 999 stating fire at Campsite.
- (4) Attack the fire using the firefighting equipment provided, if safe to do so.



NO WATER ? YOU MIGHT NEED A FIRE HYDRANT



NO FIRES ? NO COOKING IN TENTS !



FIRE SAFETY IN YURTS, PODS AND SHEPHERD HUTS



FIRE SAFETY IN YURTS, PODS AND SHEPHERD HUTS



- Fit a smoke detector where possible
- The areas in which the accommodation sits should be well lit and torches should be provided and kept in a prominent position within the unit.
- Procedures for raising the alarm should be displayed in a prominent position. They should include the address of the accommodation including the post code as visitors may well struggle to direct the emergency services to the location.
- You should consider the provision of procedures in different languages to reflect the occupation.
- The advice that should be given to occupants is to evacuate the units and dial 999, and not to tackle a fire themselves.



FIRE SAFETY IN YURTS, PODS AND SHEPHERD HUTS



- Where possible kitchens should not be included within these units.
- It should be fitted professionally by the unit provider.
- You ***must not*** have to pass the kitchen in order to evacuate the unit from the area used as sleeping accommodation.
- The unit should be ventilated to prevent a build-up of cooking fumes or other gases.
- Wood burning stoves should also be avoided and alternative, safer solutions used.



WOMAN SERIOUSLY ILL AFTER BEING PULLED OUT OF BURNING 'GLAMPING POD'



THANK YOU

